SUBMITTAL SHEET
MODEL ACEJ
J-SERIES FAN TERMINAL UNITS
PSC FAN SIZE J

Imperial [IP] Dimensions
Metric (SI) in Parentheses

CARNES COMPANY 448 S. Main St., P. O. Box 930040, Verona, WI 53593-0040 Phone: (608)845-6411 Fax: (608)845-6504 www.carnes.com

FOR LARGER IMAGES AND DIMENSIONS, REFER TO SPECIFICATION/CUT SHEET.

FAN SIZE J

RIGHT HAND PRIMARY AIR UNIT SHOWN. LEFT HAND AVAILABLE.

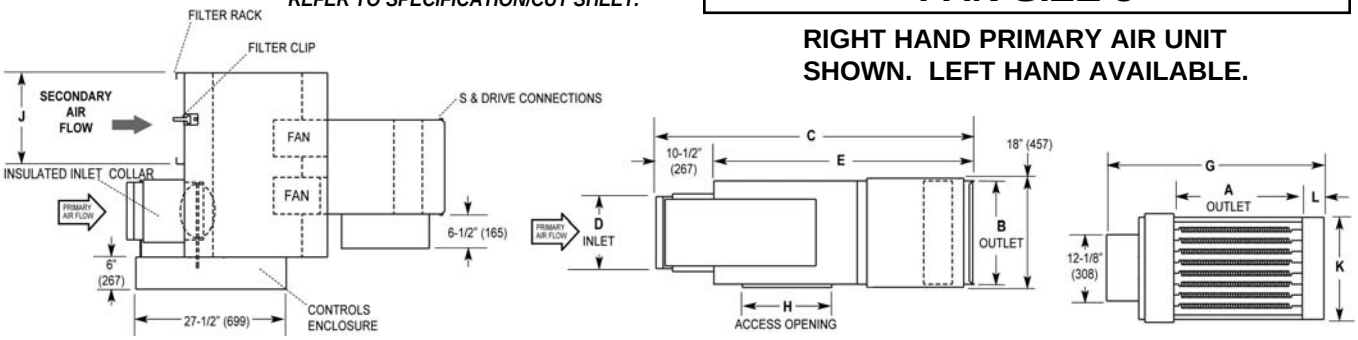

STANDARD FEATURES:

- Right Hand Controls Arrangement
- 22 Gauge Galvanized Steel
- AHRI Certified
- Patented Tri-Averaging Inlet Sensor
- Insulated Inlet Collar
- Calibration Chart Located On Inlet
- Slip & Drive Discharge Connection
- 3/8" Damper Shaft With Position Indicator Rotating In Bronze Bearings
- Valaro Type "A" Gasketed Damper Blade
- Made In America
- Bottom Access Panel
- Contactor & Capacitor
- 1" Filter Rack
- ETL Listed
- NEMA Controls Enclosure
- Door Interlocking Disconnect Switch (On Heater)
- 24 Volt Transformer
- SCR Speed Dial
- PSC Motor (Volt/Phase) _____

OPTIONS:

Insulation

- ☐ 1" Matte Faced
- ☐ 1" Foil Faced
- ☐ 1/2" Closed Cell Foam
- ☐ Dual Wall With Solid Liner
- ☐ Dual Wall With Perforated Liner

Controls

- ☐ NEMA Controls Enclosure Only (Controls By Others)
- ☐ Controls Supplied By Others, Mounted By Factory
- ☐ Factory Supplied Analog Controls With Wall T'Stat
- ☐ Pneumatic Controls (T'Stat By Others)
- ☐ Left Hand Controls

Miscellaneous

- ☐ 1" Disposable Plenum Filter
- ☐ 1" Reusable Plenum Filter
- ☐ Non-Fused Disconnect Switch (On Fan Box)
- ☐ Fused Disconnect Switch (On Fan Box)
- ☐ Factory Mounted Secondary Inlet Attenuator
- ☐ ETL Labeled

Heater

- ☐ Factory Mounted-Staged/Stepped
- ☐ Factory Mounted-SCR
- ☐ Circuit Fusing

☐ Special Construction _____ ☐ Exceptions _____

DIMENSIONS LISTED IN INCHES (Millimeters)

Fan Size	Inlet Size	Primary CFM (L/s)	Sec. CFM @ .25" E.S.P. (L/s)	Fan H.P.	Outlet A	Outlet B	C	Inlet D	E	G	H	J	K	L
J	16	4200 (1982)	4130 (1949)	3/4 (2)	42 (1067)	18-1/4 (463)	65-3/4 (1670)	15-7/8 (403)	53-1/4 (1353)	56 (1422)	17-3/4 (451)	27-7/8 (708)	18-1/4 (463)	4 (102)

Note: Outlet is designed for slip and drive duct connection.

Job Name _____ Contractor _____

Architect _____ Submitted By _____

Engineer _____ Tag/Mark _____

COPYRIGHT © 2013 CARNES COMPANY
ALL RIGHTS RESERVED