


SPECIFICATION SHEET CONSTANT FAN POWERED AIR TERMINAL ANALOG ELECTRONIC CONTROLS ET - CONTROL OPTION

CARNES COMPANY 448 S. Main St., P. O. Box 930040, Verona, WI 53593-0040 Phone: (608)845-6411 Fax: (608)845-6504 www.carnes.com

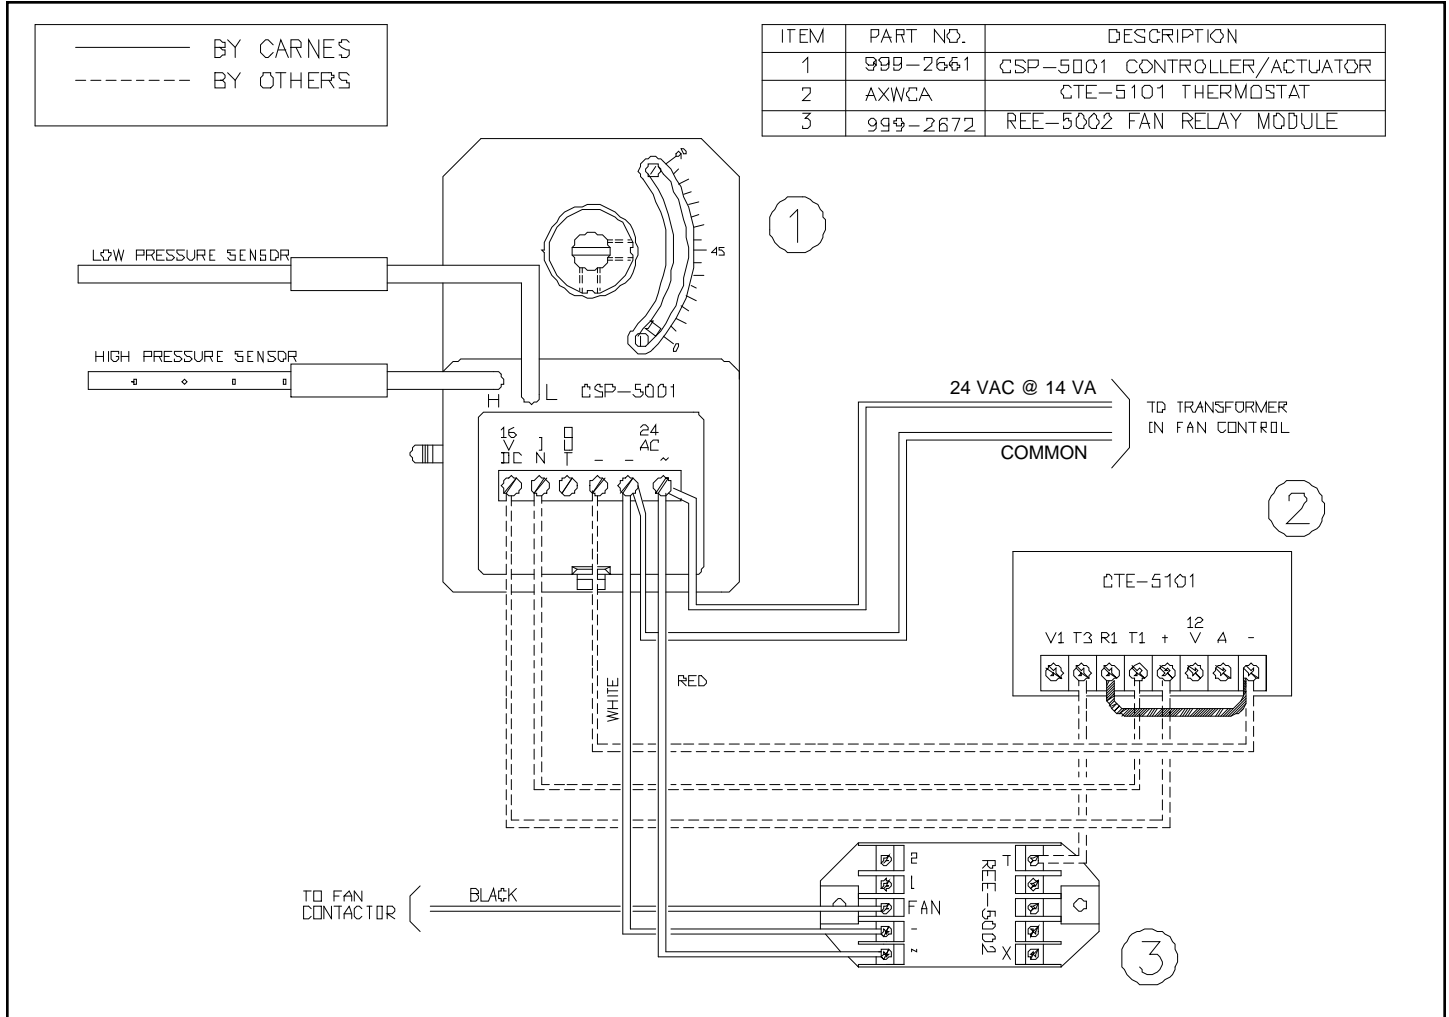

SEQUENCE OF OPERATION

THE TERMINAL UNIT FAN RUNS CONTINUOUS TO PROVIDE CONSTANT AIRFLOW TO THE ROOM.

ON A CALL FOR COOLING THE PRIMARY DAMPER OPENS TOWARDS THE MAXIMUM CFM SETTING TO SATISFY ROOM SET-POINT. AT MAXIMUM PRIMARY CFM THE FAN WILL DELIVER 100% PRIMARY AIR TO THE SPACE.

ON A CALL FOR HEATING THE PRIMARY DAMPER CLOSES TOWARDS THE MINIMUM CFM SETTING AS THIS OCCURS, PLENUM AIR IS INDUCED TO MAINTAIN CONSTANT AIRFLOW AND SATISFY ROOM SET-POINT.

CONTROL DIAGRAM

