

SINGLE DUCT VAV | Model AV



VOLARA® TYPE A gasket material is sandwiched between damper halves and has high temperature resistance, low moisture absorption and excellent chemical resistance.

Sandwich damper design is mechanically fastened to the damper shaft for low leakage, low noise, and low pressure drops. (Rigid 18 gauge construction.)

UL listed 1/2" thick, 2.0 lb./cu.ft. dual density insulation meets **UL Test 181** and **NFPA 90A** requirements (other types available).

Carnes maintenance free throttling valve assembly is isolated from the casing so that distortions in the box will not affect the blade operation.

Sturdy 22 gauge galvanized steel construction suitable for field duct connections with slip and drive cleats.

Solid steel 3/8" damper shaft rotates in oil impregnated sintered bronze bearings.

Thermally insulated inlet.

Hot water or electric heat available.

Flow measuring and balancing taps.

ARI certified data available for sound and pressure drop.



Slot in damper shaft to indicate damper position.


Tri-Averaging inlet sensor amplifies velocity pressure signals for air flow measuring and pressure independent flow control.

Calibration chart for flow measuring and balancing.

Controls enclosure.

Reliable, high quality electric, or pneumatic actuator manufactured by Carnes.


Model AV



Edges sealed with galvanized steel channels (Sterigard option).



Optional dual wall construction.



"Clean Air Option".



A Participating Member in the ARI 880 Certification Program



IAQ Insulation Available

FROM THE BUILDING DESIGN:

- Refer to the table of contents to locate the appropriate terminal unit for the application. *EXAMPLE: Cooling only — AVC.*
- Select type of external control — manual, pneumatic, electric or electronic, and pressure independent or pressure dependent. *EXAMPLE: Pressure independent pneumatic.*
- Determine minimum ventilation CFM and maximum CFM required for cooling load of zone. (Based on load calculations). *EXAMPLE: Minimum 375 and maximum 1300 CFM.*
- Find the terminal unit CFM ranges and select the terminal unit closest to, but not exceeding maximum CFM rating from **Table 1** below for pressure independent control.

- Determine maximum specified NC level at static pressure ΔP_s in ductwork to be maintained in room. Turn to the performance data of this catalog for the unit that you have selected, to determine pressure drop of unit with damper in wide open, (minimum ΔP_s). Verify that this value is below the specified maximum allowable pressure drop.

EXAMPLE: a) Specified maximum pressure drop of .25 IWC per unit.

b) Max. NC 30 at static pressure of 1-1/2".

Also, from performance data, determine the NC value at the duct static pressure. NC is typically determined at max. CFM.

REHEAT

For units requiring reheat accessories (hot water or electric duct heater), see appropriate sections in this catalog.

Examples:

Summary of Customer and Zone Requirements

Cooling ONLY application
 Pressure Independent Pneumatic Controls
 Minimum CFM = 375
 Maximum CFM = 1300
 Maximum allowable NC level = NC30
 Static Pressure in duct = 1.5 IWC
 Maximum allowable pressure drop = .25 IWC

Unit Selection

Evaluate the maximum CFM desired (1300) and select the unit from Table 1 (Pressure independent). The maximum of 1300 is within the maximum CFM range (900 - 1500) for a size 10" inlet. Verify the minimum CFM (375) is also within the minimum CFM range (300-600) for this same size 10 unit.

BEST SELECTION: SIZE 10

Pressure and Sound Considerations

Turn to performance data for the type of unit needed. Pressure drop at minimum ΔP_s for size 10 at 1300 is .00 and NC at 1.5 IWC static is 29 for discharge and 25 radiated. The AVC size 10 will meet the pressure drop (less than .25) and sound (less than NC30) requirements for this example.

Pressure Independent Control

Primary Air Inlet Parameters (Pressure Independent Control)

Table 1

Unit Size	Inlet Diameter	Rated CFM	Pneu. Minimum CFM Range	Electronic Min. CFM Range	Maximum CFM Range
05	5"	350	ø or 75 - 140	ø or 45 - 140	210 - 350
06	6"	500	ø or 110 - 200	ø or 65 - 200	300 - 500
07	7"	700	ø or 140 - 280	ø or 85 - 280	420 - 700
08	8"	1000	ø or 185 - 400	ø or 105 - 400	600 - 1000
10	10"	1500	ø or 300 - 600	ø or 155 - 600	900 - 1500
12	12"	2300	ø or 430 - 920	ø or 225 - 920	1380 - 2300
14	14"	3100	ø or 600 - 1240	ø or 335 - 1240	1860 - 3100
16	16"	4200	ø or 1100 - 2200	ø or 465 - 1680	2520 - 4200
18*	16" x 18"	5500	ø or 1100 - 2200	ø or 800 - 2200	3300 - 5500
24*	16" x 24"	7300	ø or 1480 - 2920	ø or 1095 - 2920	4380 - 7300


* For models AV and AB only.

- NOTES:**
1. Rated CFM is based on maximum inlet velocity of approximately 3000 FPM.
 2. Minimum CFM selection below this value with pressure independent control may provide less than optimum control characteristics. These values are based on an inlet velocity of approximately 365 FPM or less and/or a sensor pressure differential of approximately .035 IWC or less.
 3. CFM selections out of the recommended maximum or minimum range shown may result in less than optimum control.
 4. Minimum CFM selection is recommended to be 40% of maximum rated CFM or less.
 5. Maximum CFM selection is recommended to be 60% of maximum rated CFM or more.
 6. ADCD discharge minimums below these values will not provide adequate control.
 7. Minimum CFM for units with electric coils will vary based on kilowatts and area. See electric duct heater section for details.

(Discharge Parameters For Model ADCD)

Table 1a

Minimum Discharge CFM (See Note 6)	Maximum Discharge CFM
140	350
140	500
170	700
200	1000
380	1500
500	2300
620	3100
780	4200
—	—
—	—

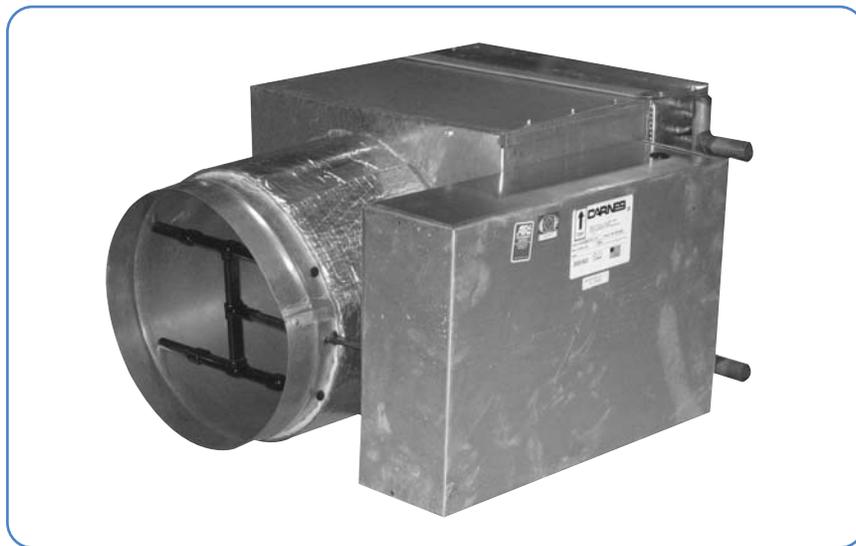

▼ Model AVW

The **Carnes Model AVW** is available as a basic control unit with hot water reheat and open end discharge, with an optional sound attenuator module.

This unit offers low pressure drop, low sound levels, and valve characteristics which create stable control conditions within the conditioned space.

Features Include:

- Air flow capacities from full shut-off to 7,300 CFM (0-3,000 FPM for each unit size).
- One to four row hot water coils come factory attached with slip and drive connections.
- Unit discharge provided with slip and drive connection for easy installation.
- Thermally and acoustically insulated casing meets **UL** and **NFPA** standards. (*Water coil casing is uninsulated.*)
- Low leakage damper design.
- Pneumatic, electric, electronic, or manual control options available.
- Tri-Averaging type air flow sensor at inlet of unit.
- Optional pressure independent and pressure dependent controls.
- Optional hanger brackets.
- Optional internal foil faced insulation.
- Optional fiber-free liner.
- Optional Sterigard.
- Optional dual wall.
- Optional external insulation.
- Optional controls enclosure.
- Optional access panel for component inspection.
- ARI certified product.

Available Modules:

- Basic Control Unit with hot water coil — **Model AVW**
- Sound Attenuator — **Model AXA**



IAQ Insulation
Available



A Participating Member
in the ARI 880
Certification Program